



# CSA10C-G090T01

V1.0





1.

CSA10C-G090T01

2.

3.

MRI

**4.**
 $T_A=25 \pm 5 \quad U_C=\pm 15V \quad R_M=5$ 

(DC)	$I_{PNDC}$	--	-10	--	10	mA
(AC rms)	$I_{PNAC}$	--	--	7	--	mA
	$I_{POL}$	1 /	-20	--	20	mA
(DC)	$U_c$		--	$\pm 15$	--	V
	$I_c$	$I_{POL}$	$\pm 20$	$\pm 40$	$\pm 100$	mA
	$K_N$		1:5			--
	$I_{SN}$		--	$\pm 50$	--	mA
	$R_M$	--	0	--	50	

**5.**

-


	$X_e$		--	--	300	
	L	--	--	--	20	
	$I_o$	25 $\pm$ 10	--	--	10	A
	$I_{OT}$		--	--	20	A
(-3 dB)	BW	--	0	--	20	kHz

**6.**

		<b>T<sub>A</sub></b>	--	-40	--	+85	
		<b>T<sub>S</sub></b>	--	-55	--	+95	
		<b>m</b>	--	200±10			<b>g</b>

8.

8.1 ( mm)

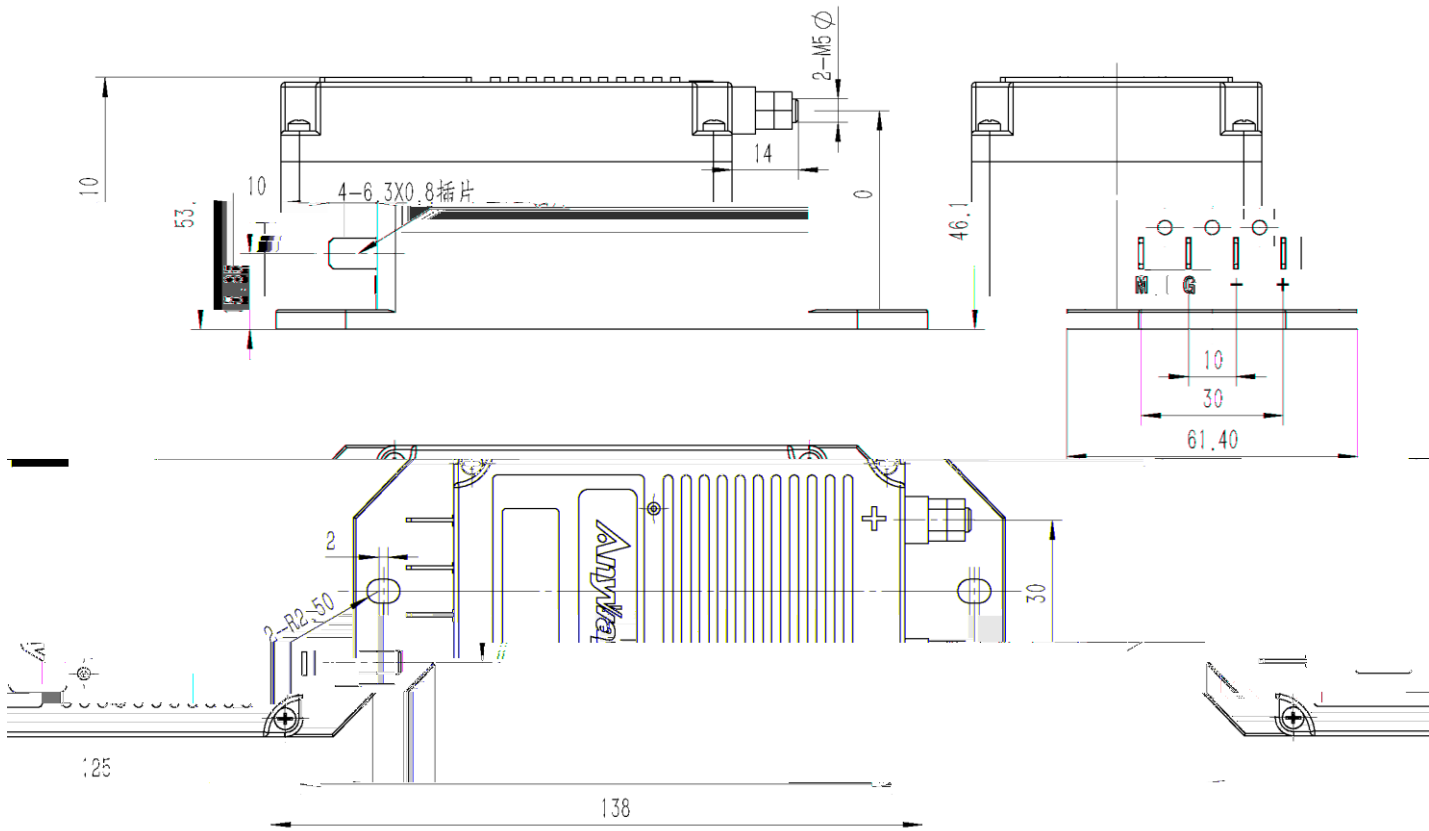

1

GB/T1804-2000 C


8.2

4 6.3  
+ +V<sub>CC</sub>  
- -V<sub>CC</sub>  
M  
G

2

+  
-



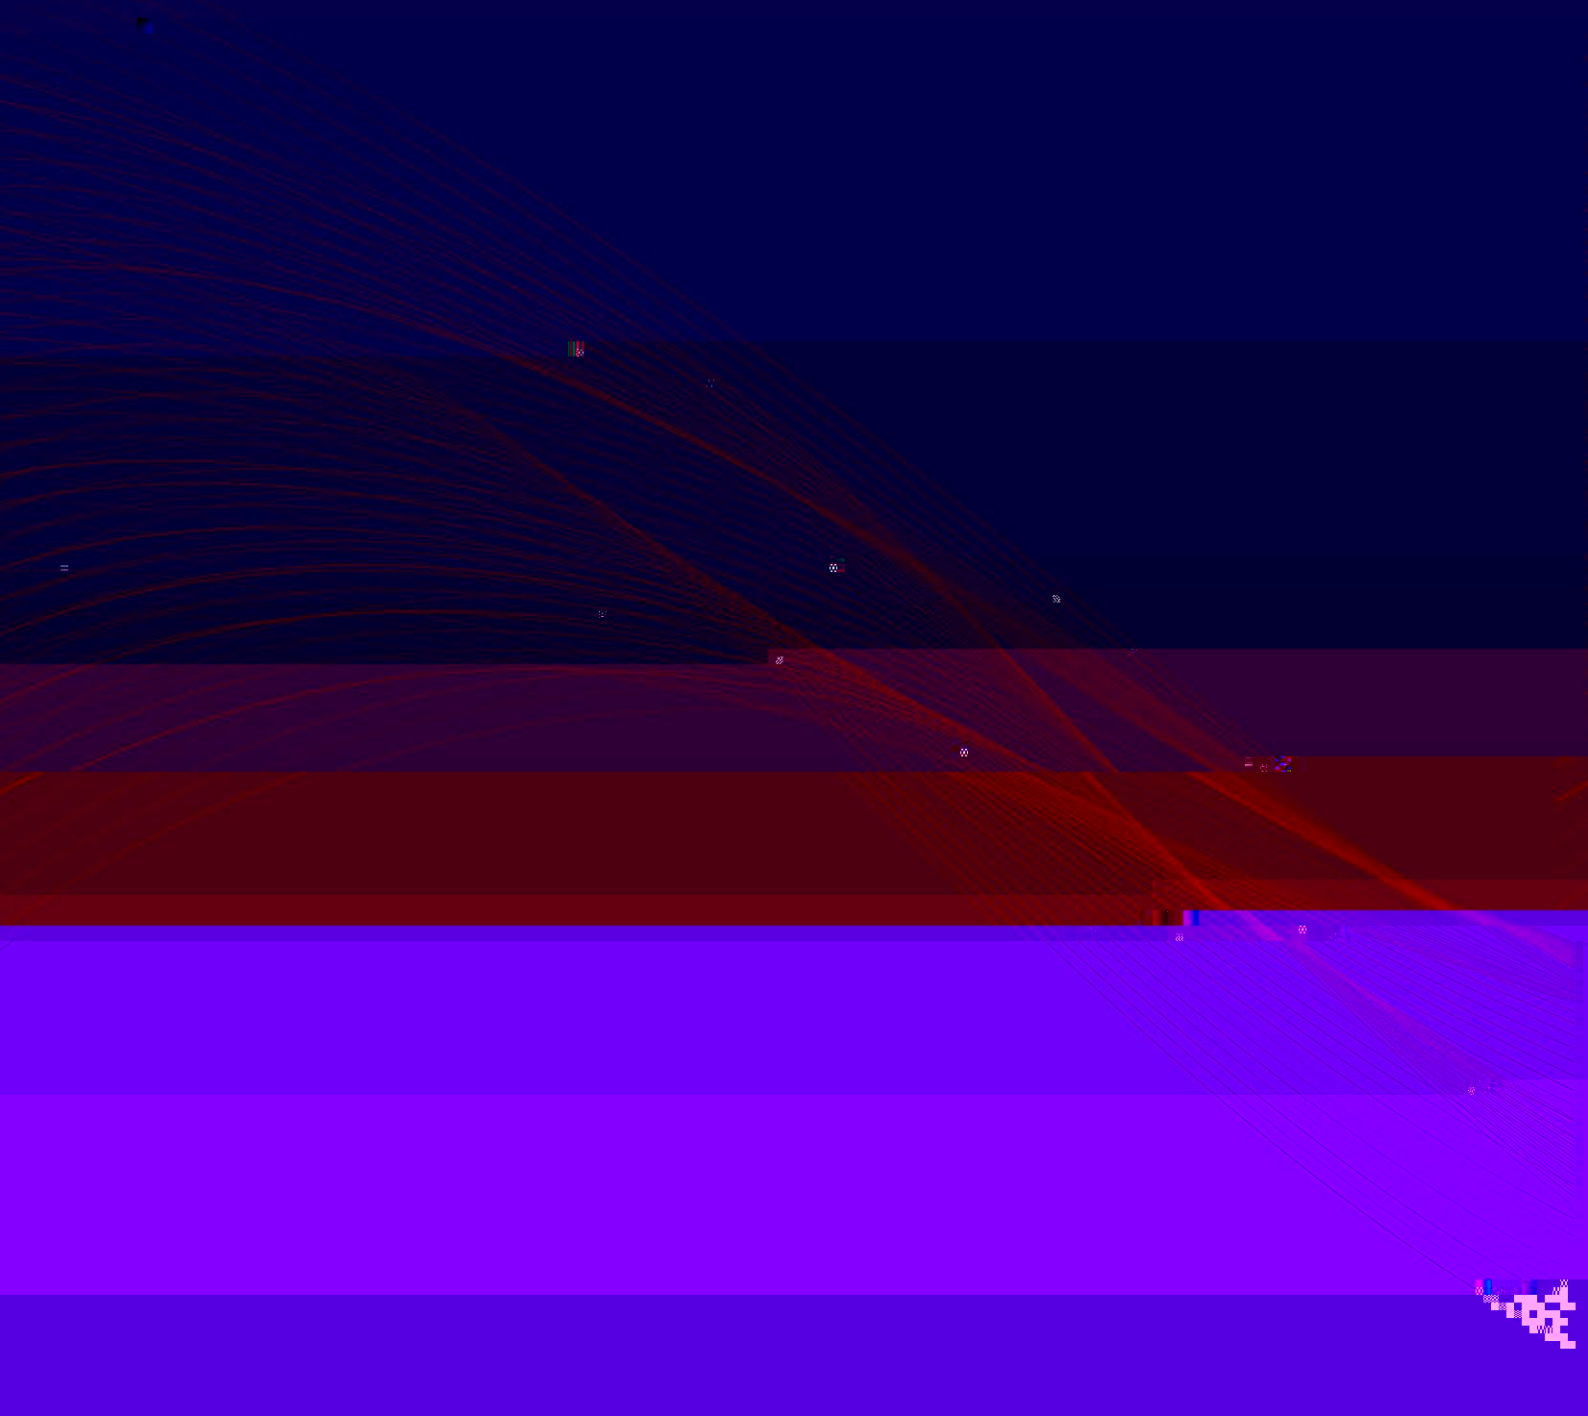

检测服务网络覆盖全国，为客户提供便捷、高效的检测服务。

